

# ENERGY FLEXIBILITY OF THERMAL ENERGY STORAGE IN THE CONTROL OF BUILDING ENERGY SYSTEMS

Christian Finck  
Eindhoven University of Technology – Building Physics and Services  
c.j.finck@tue.nl

12th IEA Heat Pump Conference, Rotterdam, May 15th-18th, 2017

## Outline

- I. Main objective PhD
- II. Thermal energy storage (TES) in buildings
- III. Simulation case study “Energy flexibility of TES in buildings with optimal control”
- IV. Current work

## I. Main objective PhD

Determination and validation of energy flexibility of thermal energy storage (TES) in the control of building energy systems

- potential energy flexibility of different TES in buildings
- potential control strategies enabling energy flexibility of TES in buildings
- simulation/experimental case studies

# II. Thermal energy storage in buildings

Power density



Energy density



Water (hot-HW, cold)

Building thermal mass (BTM)

Sensible

Phase change materials (PCM)

Ice



Latent

Thermo-chemical materials (TCM)


Thermo-chemical

## III. Simulation case study - “Energy flexibility of TES in buildings with optimal control”

Objective: Comparison of short-term energy flexibility of **different TES tanks** using optimal control

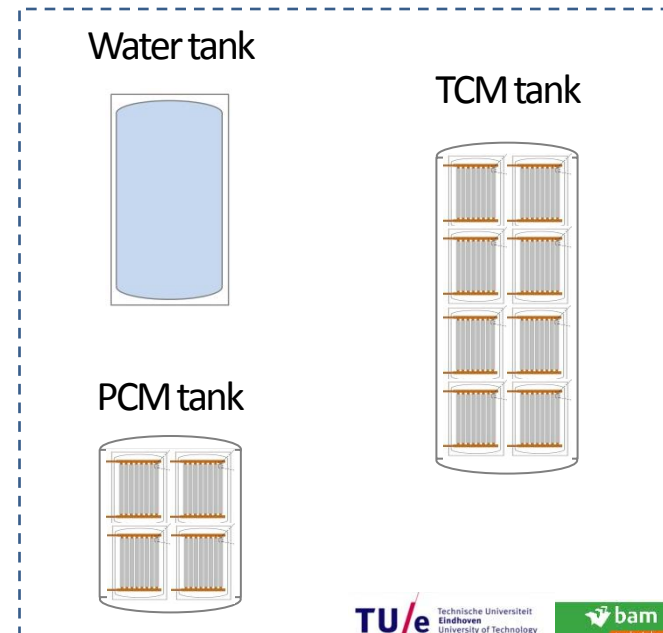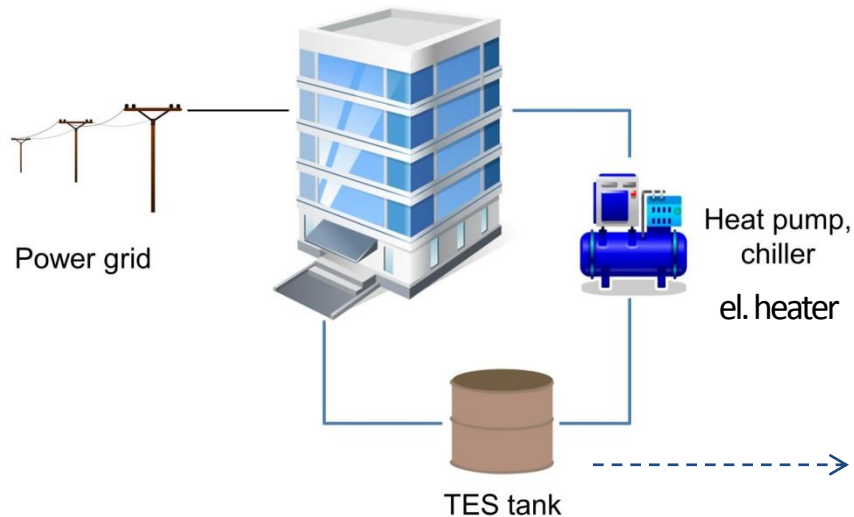

## Objective: Comparison of **short-term** energy flexibility of different TES tanks using **optimal control**

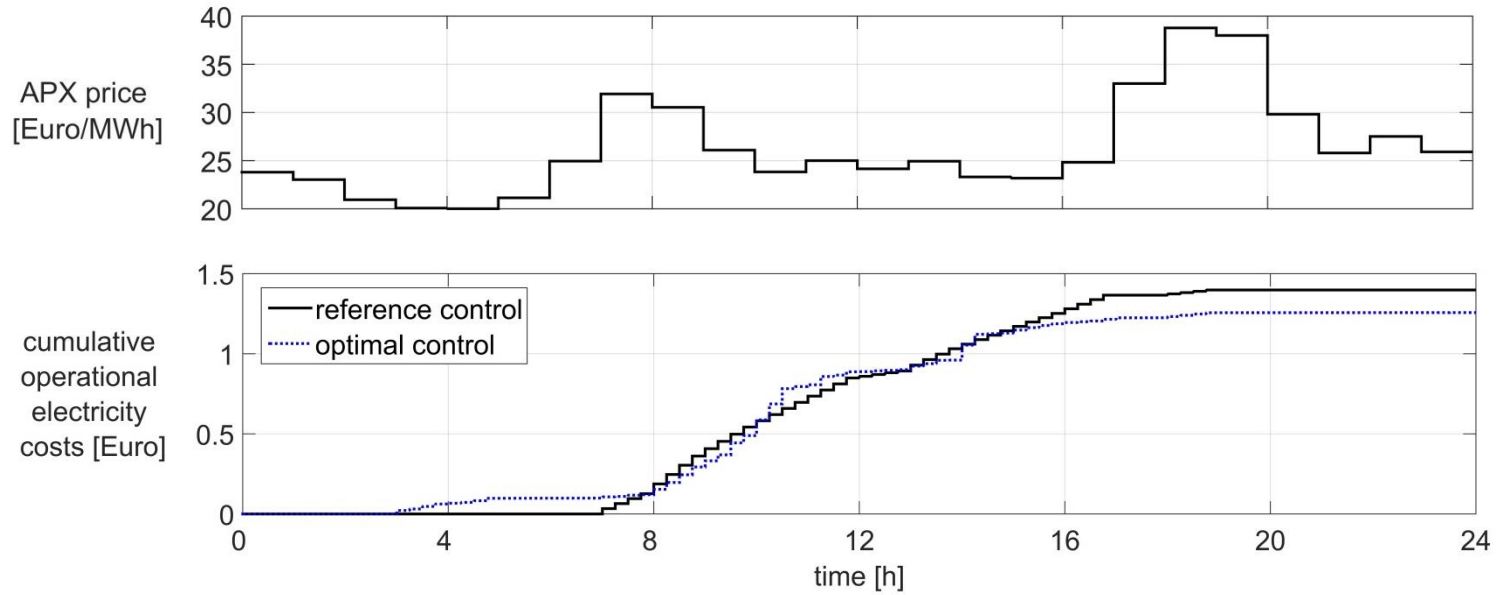

Objective: Comparison of short-term **energy flexibility** of different TES tanks using optimal control


→ Determination of energy flexibility using key performance indicators \*

*flexibility factor (ability to shift energy use for heating)*

$$\text{flexibility factor} = \frac{\int q_{\text{heating, low price time}} dt - \int q_{\text{heating, high price time}} dt}{\int q_{\text{heating, low price time}} dt + \int q_{\text{heating, high price time}} dt}$$

\* Overview of flexibility indicators in: Clauss, Finck, Vogler-Finck, Beagon – 2017 – BS2017  
 “Control strategies for building energy systems to unlock demand side flexibility – A review”

## Simulation results short-term energy flexibility with optimal control:

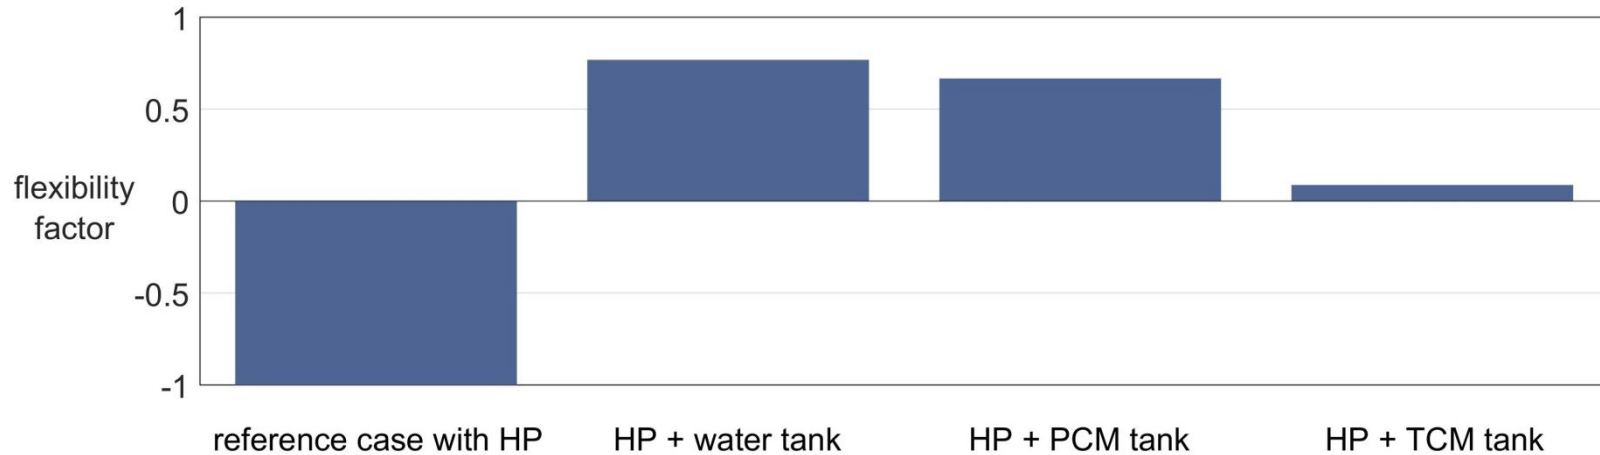



## Conclusions from case study:

- Water, PCM, and TCM tanks can be designed to provide short-term energy flexibility
  - Water, and PCM tanks can achieve higher short-term energy flexibility than TCM tanks
  - Flexibility factor has limitations
- Further work on flexibility indicators using optimal control

## IV. Current work

Experimental case study “Model-predictive control (MPC) of heating system with water TES in a Dutch residential building providing short-term energy flexibility”

### System set up:

- 23 m<sup>2</sup> PVT (Triple Solar)
- 8 kW HP (NIBE)
- 800 l space heating water tank
- 180 l domestic hot water tank

Thank you for your attention

Christian Finck  
Eindhoven University of Technology – Building Physics and Services  
c.j.finck@tue.nl